

Dressler VO-185  
242 g/mol, 15mg


9.34 7.55 7.55 7.32 7.32 7.30 7.28 7.19 2.51 2.50 2.50 2.49 2.49 2.48 2.48 2.47 2.47 2.46 2.46 2.46 2.45 2.45 2.44 1.87 1.86 1.85 1.84 1.83 1.83 1.82 1.82 1.80 1.73 1.72 1.71 1.71 1.70 1.70 1.69 1.68 1.68 1.67 1.65 1.64 1.63 1.63 1.62 1.61 1.61 1.60 1.59 1.59 1.59 -0.00



Current Data Parameters  
NAME Aug31-2023HD\_VO  
EXPNO 130  
PROCNO 1

F2 - Acquisition Parameters  
Date\_ 20230831  
Time 8.31 h  
INSTRUM spect  
PROBHD Z125339\_0010 (  
PULPROG zg30  
TD 65536  
SOLVENT CDC13  
NS 32  
DS 2  
SWH 8012.820 Hz  
FIDRES 0.122266 Hz  
AQ 4.0894465 sec  
RG 200.5  
DW 62.400 usec  
DE 6.50 usec  
TE 298.5 K  
D1 1.00000000 sec  
TD0 1  
SFO1 400.2524715 MHz  
NUC1 1H  
P1 15.00 usec  
PLW1 25.02099991 W

F2 - Processing parameters  
SI 65536  
SF 400.2500393 MHz  
WDW EM  
SSB 0  
LB 0.30 Hz  
GB 0  
PC 1.00

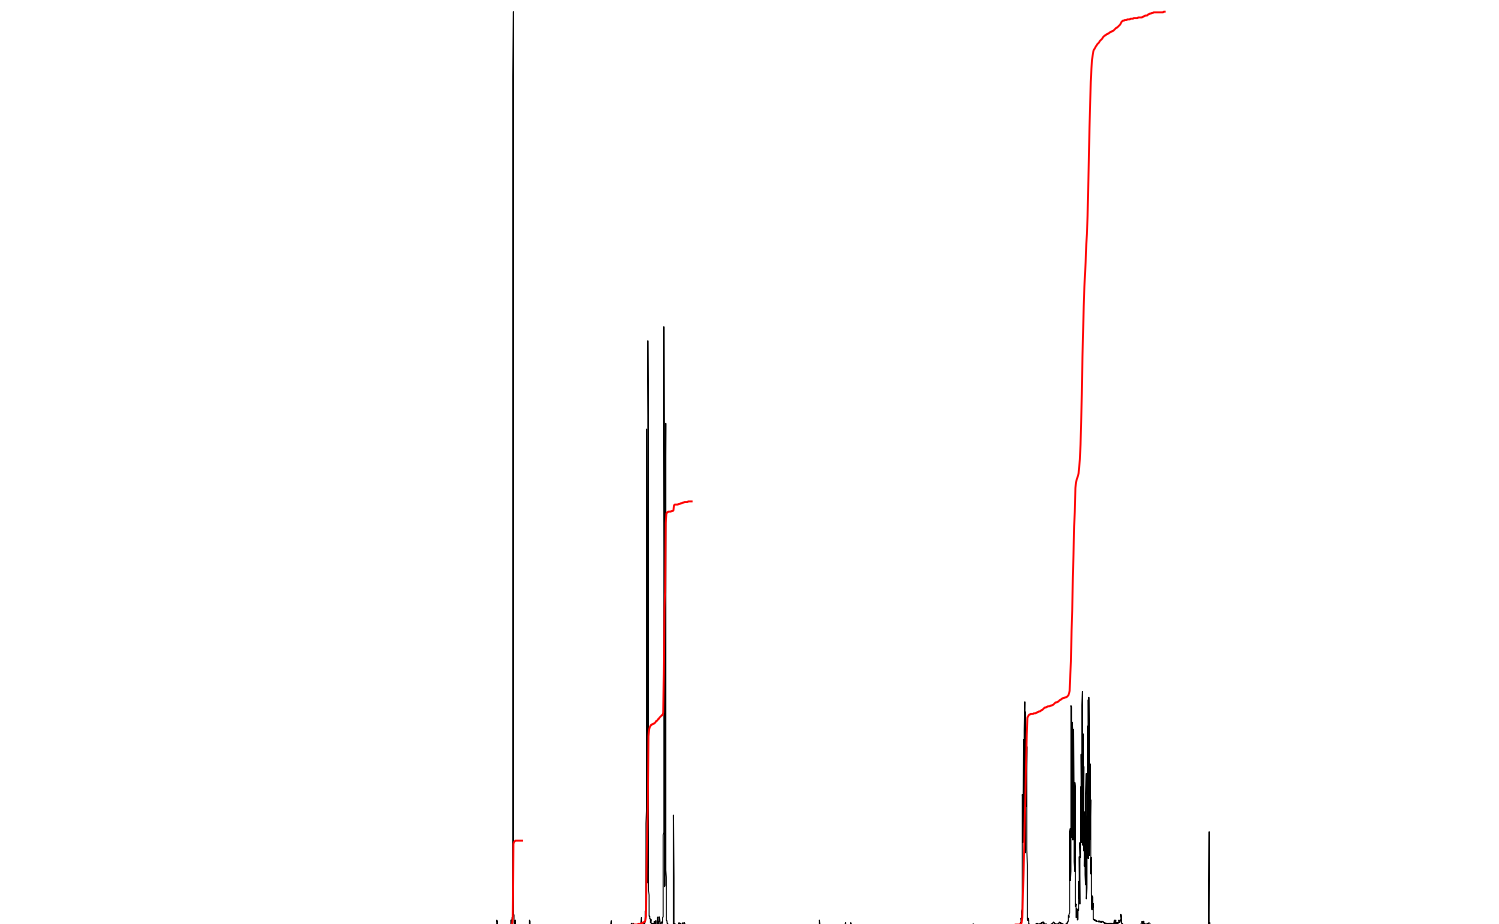

15 14 13 12 11 10 9 8 7 6 5 4 3 2 1 0 -1 -2 ppm

5.98

29.81

64.20